

Annexure C

PROFORMA FOR SAFE DRINKING WATER AND SANITARY CONDITION CERTIFICATE

No.

Dated: 04/03/2025

It is certified that an inspection team headed by Gopal Das

(Name of Officers with designation) from Ananda Niketan water testing PHED

inspected the SAINI INTERNATIONAL SCHOOL HOWRAH, NH-6, SURIKHALI HOWRAH-711322

(Name & Address of the school) on 15/02/2025 (date of inspection) and on the basis of

Water Test Report (Attached) bearing no. 2358 dated 11/02/2025

of Ananda Niketan water testing Laboratory (PHED Lab) certified that the

SAINI INTERNATIONAL SCHOOL HOWRAH (Name of school) has safe drinking water

facilities for the students and members of staff of the institution. School is also maintains the

hygienic sanitation condition in the school building & the campus as per norms prescribed by the

Central/ State/ U.T. Govt.

This certificate is valid till 3 YEARS

Signature with Seal:

Name

Designation


Name & Address of the Office / Department

Gopal Koley
Basudevpur Gram Panchayat Head

To SAINI INTERNATIONAL SCHOOL HOWRAH

NH-6, SURIKHALI, HOWRAH-711322

(Name & Address of the Institution)

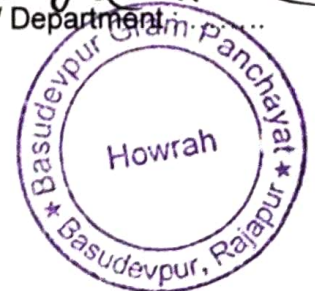

Note: The certificate is to be issued by authorized officer / PHED Lab / local bodies

ANANDA NIKETAN WATER TESTING LABORATORY



No. 2358

Bagnan, Howrah

Rural drinking water quality monitoring, Surveillance and Improvement Programme

Under PHED, P&RD and Health & Family Welfare, Government of West Bengal



Name of Owner :-	Saini International School	Dag No.:-
Name of the Block/M.C.	Uluberia-II Howrah.	Kh. No.:-
Name of the G.P./Ward No. :-	Basudebpur	Memo / W.O. No. :-
Name of the Village (Mouja) & JL No.:-	Surikhali	Dated :-
Name of the Habitation :-	Surikhali	NIT No. :-
Location of the Tube Well :-	Saini International School, Howrah	Dated :-
Date of Collection :-	10/02/25	Date of Testing :-
	11/02/25	Sample Collected by
		Bishnudev Bangal

TESTING RESULT

Sl. No.	a) Chemical Parameter	Desirable Limit	Permissible Limit	Result	Remarks
01	PH	6.5 - 8.5	No relaxation	7.65	Drinkable
02	Iron (mg/L)	0.1	1	0.19	
03	Total Hardness (mg/L)	200	600	188	
04	Arsenic (mg/L)	0.01	No relaxation	BDL	
05	Salinity		No relaxation	0.4	
06	Manganese (mg/L)	0.1	0.3	0.012	
07	Turbidity (mg/L)	1	5	0.39	
B) Bacteriological Paramater :-					
			Permissible Limit	Result	
01	Total Coliform (MFT/Per 100 ml)		0	0	
02	Feacal Coliform (MFT/per 100 ml)		0	0	

Signature of Chemist

Signature of the Bacteriologist

Lab In charge

Signature of Secretary

General Secretary
ANANDA NIKETAN

General Secretary
ANANDA NIKETAN
Bagnan, Howrah